

LEGEND


FIREWATER MAIN TO BUND STORAGE TANK	150mm
SEAWATER RISING MAIN	250mm
SEAWATER RISING MAIN FIRE TAKE OFF POINT	●
FIXED FOAM MONITOR	⊠
EXISTING SALTWATER RISING MAIN FIRE TAKE OFF POINT	○
EXISTING SALTWATER RISING MAIN	250mm

Proposed Seawater Rising Main

Proposed Seawater Rising Main Take Off Point

Proposed Water and Foam Main and Saltwater Main Pump House

Proposed Water and Foam Main from Pump House

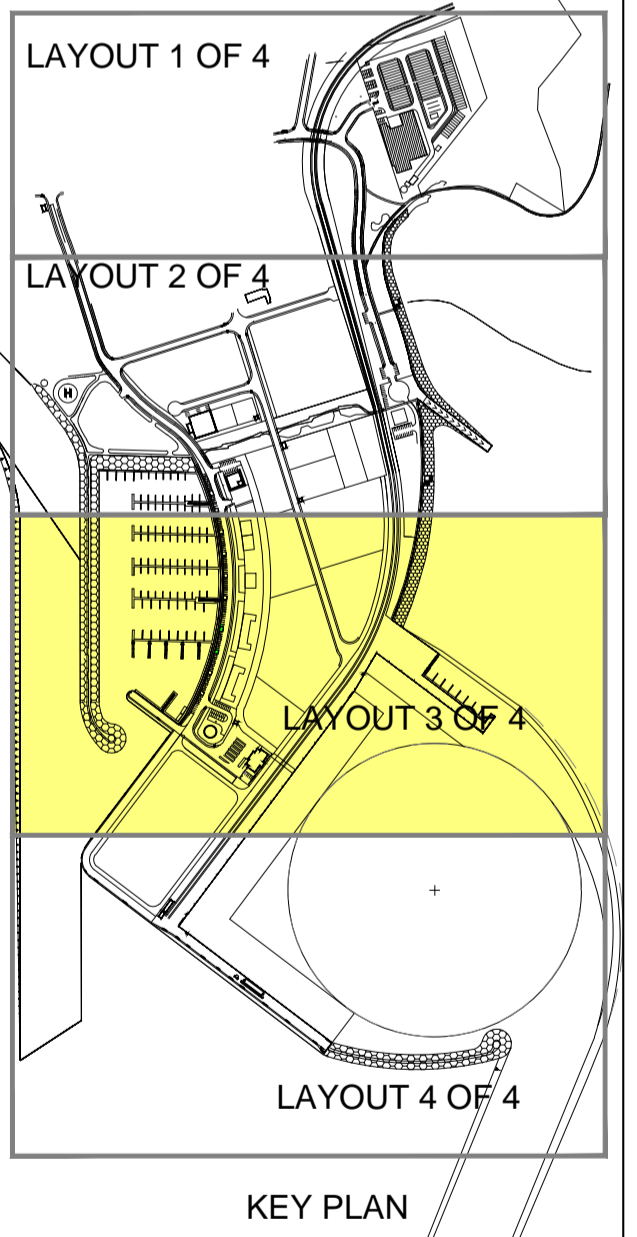

- NOTES:**
- FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
 - ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE
 - ENGINEER/EMPLOYERS REPRESENTATIVE, AS APPROPRIATE, TO BE INFORMED BY THE CONTRACTOR OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES
 - THE CONTRACTOR SHALL UNDERTAKE THOROUGH CHECK FOR THE ACTUAL LOCATION OF ALL SERVICES/UTILITIES, ABOVE AND BELOW GROUND, BEFORE ANY WORK COMMENCES
 - ALL LEVELS SHOWN RELATE TO ORDNANCE SURVEY DATUM AT MALIN HEAD

Rev	Date	Description	By	Chkd.
A	JAN 2014	FIRST ISSUE	JOM	JPK

Client: GALWAY HARBOUR COMPANY

Project: GALWAY HARBOUR EXTENSION

Title: SALTWATER & FIREFIGHTING FOAM MAIN SHEET 3 OF 4

Prepared by: JOM

Checked: BH

Date: JAN 2014

Project Director: J.P. KELLY

Drawing Status: Planning & EIS

Scale @ A1: 1/1000 A3 1/2000

TOBIN Consulting Engineers, Fairgreen House, Fairgreen Road, Galway, Ireland.
 tel: +353-(0)91-565211
 fax: +353-(0)91-565398
 e-mail: galway@tobin.ie
 www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and provided. Except where specifically and explicitly agreed in writing by TOBIN Consulting Engineers, as copyright holder, no part of this document may be reproduced or transmitted in any form and this document shall not be relied upon by any third party for any purpose.

Drawing No.: **2139-2230**

Revision: **A**